



Air Handler Mounting Detail


OPTION 1 - TRAPEZE

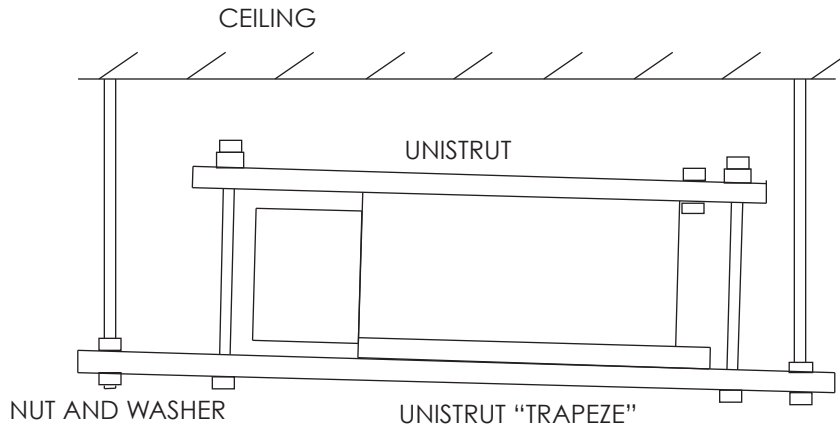


OPTION 2 - DIRECTLY MOUNTED

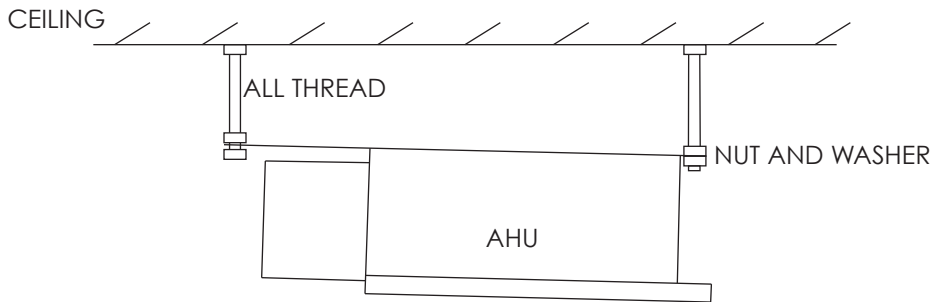

MOUNTING HOLE DIMENSIONS; SURNA 5 TON

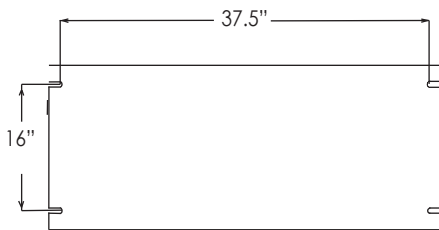

PLUMBING SCHEMATIC

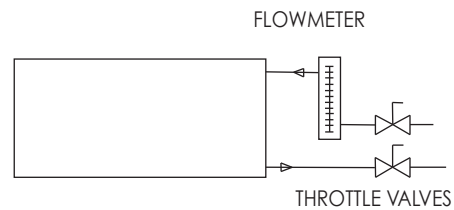

NOTES:

1. HANG AHU AT AN ANGLE WITH .25 INCH PER FOOT OF SLOPE FOR PROPER DRAINAGE OF CONDENSATE
2. DWYER FLOWMETER RECOMMENDED AS STANDARD. OTHER OPTIONS EXIST FOR BALANCING. PRESSURE INDEPENDANT BALANCING VALVES OR ULTASONIC FLOWMETERS ARE ACCEPTABLE. EACH AHU MUST BE ABLE TO BE ISOLATED FOR SERVICE USING ISOLATION VALVES. ISOLATION VALVES MAY BE USED FOR THROTTLING FLOW.